

The effect of aerated rock filter geometry on the rate of nitrogen removal from facultative pond effluents

R. Hamdan^{1,2} and D. D. Mara¹

¹ School of Civil Engineering, University of Leeds, Leeds LS2 9JT, UK
(E-mail: cnrh@leeds.ac.uk and d.d.mara@leeds.ac.uk)

² University Tun Hussein Onn Malaysia, 86400 Batu Pahat, Johor, Malaysia
(E-mail: rafidahh@uthm.edu.my)

Abstract

Rock Filters are an established technology for polishing waste stabilization pond effluents. However, they rapidly become anoxic and consequently do not remove ammonium-nitrogen. Horizontal-flow aerated rock filters (HFARF), developed to permit nitrification and hence ammonium-N removal, were compared with a novel vertical-flow aerated rock filter (VFARF). There were no differences in the removals of BOD₅, TSS and TKN, but the VFARF consistently produced effluents with lower ammonium-N concentrations (<0.3 mg N/L) than the HFARF (0.8–1.5 mg N/L).

Keywords

Aerated rock filters; ammonium nitrogen; facultative ponds; horizontal flow; vertical flow

INTRODUCTION

Rock filters (RF) are a well-established technology for ‘polishing’ maturation pond effluents to provide high-quality effluents in terms of BOD and total suspended solids (TSS) (O’Brien et al., 1973; Martin and Weller, 1973; Swanson and Williamson, 1980; Middlebrooks, 1988, 1995; Saidam et al., 1995; Neder et al., 2002; US EPA, 2002). However, these RF rapidly become anoxic and there is no (or very little) removal of ammonia. To remove ammonia the RF must be aerated and it is better to treat facultative (rather than maturation) pond effluents in aerated RF so as to remove the need for maturation ponds and thus save land; aeration also improves BOD and TSS removals (Johnson 2005; Mara and Johnson and Mara 2006). Johnson and Mara (2007) found that an aerated RF outperformed an unaerated subsurface horizontal-flow constructed wetland (SSHFCW) and Mara (2006) showed that the combination of a primary facultative pond and an aerated RF produced a better quality effluent, required less land, and was cheaper, than a septic tank and SSHFCW. [Aeration has also been proposed for SSHFCW by Davies and Hart (1990), Cottingham et al. (1999), Maltais-Landry et al. (2007) and Ouellet-Plamondon et al. (2007).]

In this paper we report results obtained from two pilot-scale aerated RF of very different geometries. Both received the same volumetric hydraulic loading and air flow rates, but one had a depth of 0.5 m (as in the original work by Johnson, 2005) and the other a depth of 2 m.

MATERIALS AND METHODS

Pilot-scale units

The facultative pond was loaded at 80 kg BOD/ha day (Abis and Mara, 2003) using a variable-speed peristaltic pump (Watson Marlow model 505S pump fitted with a model 501RL pump head). A vertical-flow aerated RF (VFARF) and a horizontal-flow aerated RF (HFARF) were operated in parallel at our experimental station at Yorkshire Water’s Wastewater Treatment Works at Esholt, Bradford. The dimensions and operating conditions of the two RF are given in Table 1 and they are shown in Figures 1 and 2.

The rock filters were filled with 40–100 mm limestone aggregate and aerated using an oil-free Jun-air compressor (model OF302-25B) at an air flow rate of 20 L/min. The 12-mm reinforced plastic pipework, used to convey the facultative pond effluent to the RF, was heated during winter using a T-type thermocouple (model DTC 410 with temperature control) and a heating cable (Flexelec model FTP). A flow meter was installed at the inlet of the VFARF to monitor the flow to it and airflow meters were installed for both RF. The RF effluents were discharged by gravity to the nearest drain.

Table 1. Dimensions and operating conditions of the aerated RF

Parameter	VFARF	HFARF
Height (m)	2.0	0.5
Width (m)	–	0.5
Length (m)	–	4.0
Internal diameter (m)	0.3	–
Filter bed depth/ Liquid depth (m)	1.8 / 1.5	0.6 / 0.5
Rock volume (m ³)	0.12	1
Wastewater flow (ml/min)	50	420
Velocity (m/s)	1.18×10^{-5}	2.8×10^{-5}
Hydraulic retention time (d)	1.6	1.6
Hydraulic loading rate (m ³ /m ³ d)	0.6	0.6
Airflow rate (L/min)	20	20
Sampling points (m below surface)	0.25, 0.5, 0.75, 1.0, 1.25, 1.5	–



Figure 1. The HFARF (unit on the right).



Figure 2. The VFARF.

Wastewater sampling and analysis

Grab samples of the influent and effluent of the two RF were collected and analysed weekly, following *Standard Methods* (APHA, 1998), for BOD (method no. 5210 B), ammonia (4500-NH₃ D), TKN (4500-N_{org} C) and TSS (2540 D). Dissolved oxygen (DO), pH, and temperature were measured in situ using a sonde probe (YSI model 610-DM), and nitrate was analysed weekly by an ion analyser (DIONEX model DX500). All laboratory analyses were conducted in the Public

Health Engineering Laboratories, School of Civil Engineering, University of Leeds (16 km from Esholt).

RESULTS AND DISCUSSION

BOD₅ removal

Generally BOD₅ removal was slightly higher in the VFARF than in the HFARF. The BOD₅ removal efficiency of the VFARF varied from 67 to 90% and in the HFARF from 48 to 84%. As shown in Figure 3, the BOD₅ concentration in the RF influents was in the range 21–80 mg/L; in the VFARF effluent it was 7–9 mg/L and in the HFARF effluent 9–14 mg/L (these effluent ranges are not significantly different – student *t* test: $p = 0.14$). Both effluents complied with the BOD₅ requirements of the EU Urban Waste Water Treatment Directive (UWWTD) (Council of the European Communities, 1991).

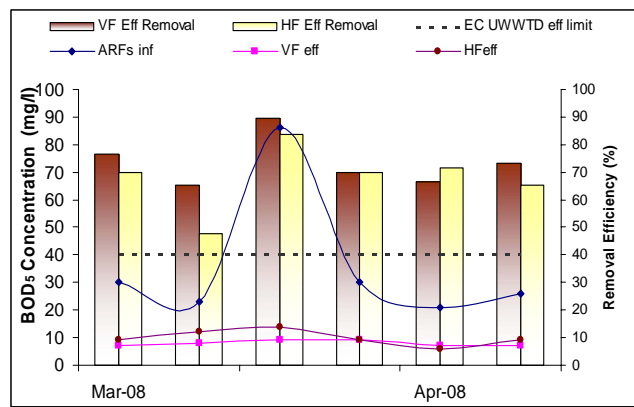


Figure 3. VFARF and HFARF influent and effluent BOD₅ concentrations and removal efficiencies.

TSS removal

Figure 4 shows that the HFARF performed slightly better than the VFARF but the effluent TSS concentrations were not significantly different (*t* test: $p = 0.37$); both complied with the requirements of the UWWTD.

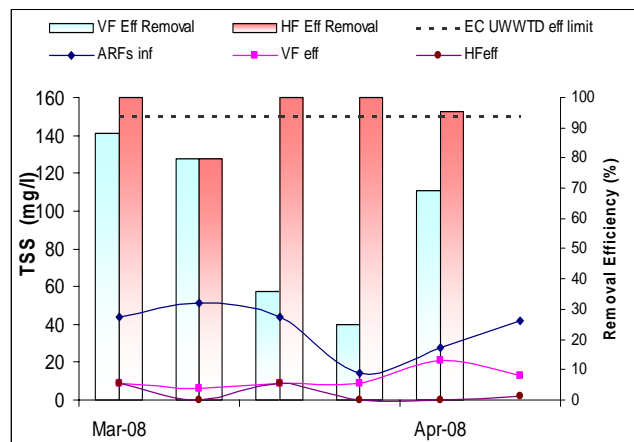


Figure 4. VFARF and HFARF influent and effluent TSS concentrations and removal efficiencies.

ACKNOWLEDGEMENTS

We wish to acknowledge Yorkshire Water for providing not only the WSP experimental site at Esholt, but also for their almost daily help at the site.

REFERENCES

- Abis, K. L. and Mara, D. D. (2003). Research on waste stabilisation ponds in the United Kingdom: Initial results from pilot-scale facultative ponds. *Water Science and Technology* **48** (2), 1–8.
- APHA (1998). *Standard Methods for the Examination of Water and Wastewater*, 20th ed. American Public Health Association, Washington, DC.
- Cottingham, P. D., Davies, T. H. and Hart, B. T. (1999). Aeration to promote nitrification in constructed wetlands. *Environmental Technology* **20** (1), 69–75.
- Council of the European Communities (1991). Council Directive 91/271/EEC of 21 May 1991 concerning urban waste water treatment. *Official Journal of the European Communities* L135, 40–52 (30 May).
- Davies, T. H. and Hart, B. T. (1990). Use of aeration to promote nitrification in reed beds treating wastewater. In *Constructed Wetlands in Water Pollution Control* (ed. Cooper, P. F. and Findlater, B. C.), pp. 383–389. Pergamon Press, Oxford.
- Johnson, M. L. (2005). Aerated rock filters for enhanced ammonia and faecal coliform removal from facultative pond effluents. *Journal of the Chartered Institution of Water and Environmental Management* **19** (5), 143–146.
- Johnson, M. L. and Mara D. D. (2007). Ammonia removal from facultative pond effluents in a constructed wetland and an aerated rock filter: performance comparison in winter and summer. *Water Environment Research* **79** (5), 567–570.
- Maltais-Landry, G., Chazarenc, F., Comeau, Y., Troesch, S. and Brisson, J. (2007). Effects of artificial aeration, macrophyte species, and loading rate on removal efficiency in constructed wetland mesocosms treating fish farm wastewater. *Journal of Environmental Engineering and Science* **6** (4), 409–414.
- Mara, D. D. (2006). Constructed wetlands and waste stabilization ponds for small rural communities in the United Kingdom: a comparison of land area requirements, performance and costs. *Environmental Technology* **27** (4), 573–757.
- Mara, D. D. and Johnson, M. L. (2006). Aerated rock filters for enhanced ammonia and fecal coliform removal from facultative pond effluents. *Journal of Environmental Engineering, American Society of Civil Engineers* **132** (4), 574–577.
- Martin, J. L. and Weller, R. (1973). *Removal of Algae from Oxidation Pond Effluent by Upflow Rock Filtration*. Department of Civil Engineering, University of Kansas, Lawrence, KS.
- Middlebrooks, E. J. (1988). Review of rock filters for the upgrade of lagoon effluents. *Journal of the Water Pollution Control Federation* **60** (9), 1657–1662.
- Middlebrooks, E. J. (1995). Upgrading pond effluents: an overview. *Water Science and Technology* **31** (12), 353–368.
- Neder, K. D., Carneiro, G. A., Queiroz, T. R., and de Souza, M. A. A. (2002). Selection of natural treatment processes for algae removal from stabilisation pond effluents in Brasília, using multi-criterion methods. *Water Science and Technology* **46** (4–5), 347–354.
- O'Brien, W. J.; McKinney, R. E.; Turvey, M. D.; Martin, D. M. (1973) Two methods for algae removal from wastewater stabilization ponds. *Water & Sewage Works Journal* **120** (3), 66–73.
- Ouellet-Plamondon, C., Chazarenc, F., Comeau, Y. and Jacques Brisson, J. (2007). Artificial aeration to increase pollutant removal efficiency of constructed wetlands in cold climate. *Ecological Engineering* **27** (3), 258–264.
- Saidam, M. Y., Ramadan, S. A., and Butler, D. (1995). Upgrading waste stabilization pond effluent by rock filters. *Water Science and Technology* **31**(12), 369–378.
- Swanson, G. R., and Williamson, K. J. (1980). Upgrading lagoon effluents with rock filters. *Journal of the Environmental Engineering Division, American Society of Civil Engineers* **106** (EE6), 1111–1129.
- US EPA (2002). *Rock Media Polishing Filter for Lagoons* (Wastewater Technology Fact Sheet No. EPA 832-F-02-023). Office of Water, US Environmental Protection Agency, Washington, DC.